



Republic of the Philippines  
GENERAL SANTOS CITY WATER DISTRICT  
E. Fernandez Street, Barangay Lagao General Santos  
Telephone No.: 552-3824; Telefax No.: 553-4960  
Email Address: gscwdprocurement@yahoo.com

GPM-014-3

**REQUEST FOR QUOTATION**

RFQ #: 3-0423-031      DATE: 04/26/2023

SUPPLIER: \_\_\_\_\_  
ADDRESS: \_\_\_\_\_  
TELEPHONE NO. : \_\_\_\_\_  
TIN NO. : \_\_\_\_\_

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 05/02/2023, Pls. furnish this office the following articles subject to the terms and conditions contained therein.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	D.I. GATEVALVE 75MM F/F : WITH HOT DIP GALVANIZE BOLTS & NUTS; PN16; 10YEARS WARRRANTY-ABC: PHP 120,000.00	10	pcs.	P
2	D.I. GATEVALVE 100MM (4``) F/F : WITH HOT DIP GALVANIZE BOLTS & NUTS; PN16; 10YEARS WARRRANTY-ABC: PHP 150,000.00 ##### nothing follows #####	10	pcs.	P

Delivery term: \_\_\_\_\_  
Price Validity : \_\_\_\_\_  
Terms of Payment: \_\_\_\_\_

Place of Delivery: GSCWD Bodega  
\*\*\*\*\*No partial delivery allowed\*\*\*\*  
Note: 6% WITHHOLDING TAX DEDUCTION  
PR NO.: 0323-091

Requested by:


  
**GESEM R. CABAÑERO**  
MATERIAL PROCUREMENT  
OFFICER A

Price quoted by:

\_\_\_\_\_  
Supplier

\_\_\_\_\_  
Date

# DUCTILE IRON GATE VALVE

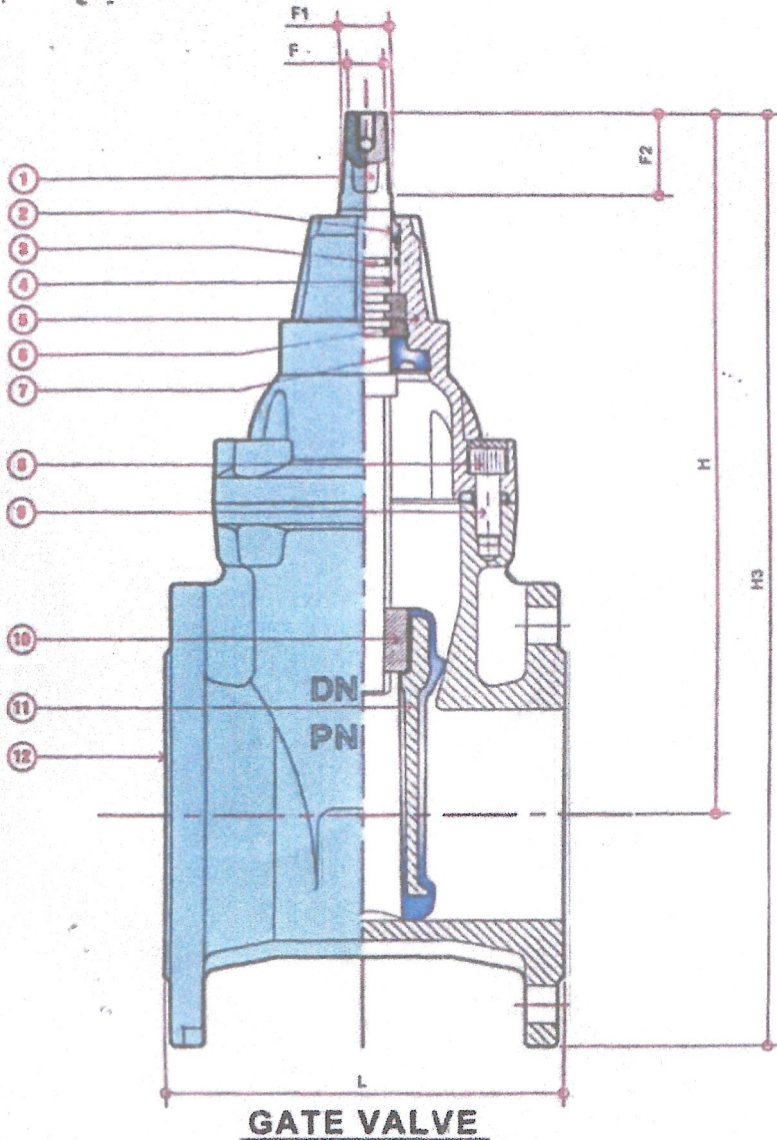

### COMPONENT LIST:


1. Stem	Stainless steel
2. Wiper Ring	NBR rubber
3. O-ring	NBR rubber
4. Bearing	Polyamide
5. Bonnet	Ductile Iron
6. Thrust Collar	Dezincification Resistant Brass
7. Manchette	EPDM Rubber
8. Bonnet Bolt	Stainless Steel
9. Bonnet Gasket	EPDM Rubber
10. Wedge Nut	Dezincification Resistant Brass
11. Wedge	Ductile Iron with EPDM Rubber
12. Body	Ductile Iron

### DIMENSIONS:

DN	Flange drilling	L	H	H3	F	F1	F2	W	Theoretic weight	Flange Hole No.	Bolt Size (Ø x L)
mm(in)		(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(mm)	(kg)	(pcs)	(mm)
50(2")	PN10/16	178	208	290	14	17	29	165	11	4	15 x 63.5
75(3")	PN10/16	203	282	382	17	20	34	200	18	6	15 x 63.5
100(4")	PN10/16	229	305	415	19	22	34	220	17	6	15 x 63.5
150(6")	PN10/16	267	401	543	19	22	34	285	32	8	18 x 75
200(8")	PN16	292	490	660	24	27	34	340	51	12	18 x 75
250(10")	PN16	330	625	825	27	31	47	400	82	12	21 x 75
300(12")	PN16	365	707	934	27	31	47	455	118	12	25 x 100

**BOLTS: HOT DIP GALVANIZED WITH NUT AND WASHER.**

**GATE VALVE**

 <p><b>GENERAL SANTOS CITY WATER DISTRICT</b> 12, FERNANDEZ STREET, URAY, LAGAO, GEN. SANTOS CITY ENGINEERING &amp; CONSTRUCTION DEPARTMENT PLANNING AND DESIGN DIVISION TEL. NO.: (083) 882 - 8824</p>	PROJECT TITLE / LOCATION	CHECKED BY:	REVIEWED BY:	APPROVED BY:	CONTENT:	SHEET NO.:	
	STANDARD SHOP DRAWING FOR D.I. GATE VALVE	ENGR. DANLO M. HORLADOR, JR. <i>Danlo M. Horlador, Jr.</i> Project Planning & Development Officer A	ENGR. MARIA CELIA N. DANDAN <i>María Celia N. Dandan</i> OIC Planning & Design Division	ENGR. ROGELIO A. BESANA, JR. <i>Rogelio A. Besana, Jr.</i> AGM - Operations & Technical Services	AS SHOWN		
						DRAWN: ESA REVISION: CHECKED: DATE: 10 / 03 / 2022	