



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
E. Fernandez Street, Barangay Lagao General Santos
Telephone No.: 552-3824; Telefax No.: 553-4960
Email Address: gscwdprocurement@yahoo.com

GPM-014-4

REQUEST FOR QUOTATION

RFQ #: 3-0424-001 DATE: 4/1/2024

SUPPLIER: _____
ADDRESS: _____
TELEPHONE NO. : _____
TIN NO. : _____

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 4/5/2024, Pls. furnish this office the following articles subject to the terms and conditions contained therein.

Instructions :

1. Accomplish this Request for Quotation duly, correctly, and completely.
2. Do not alter the contents of this form in any way.
3. If Technical Specifications/ Terms of Reference is provided, prospect bidder (supplier / service provider) must indicate and signify compliance to every parameter in the specification.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	PILOT LIGHT, 220V, YELLOW : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 25,000.00	10	pc	P
2	SELECTOR SWITCH : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 10,000.00	10	pc	P
3	TIMER RELAY 12V DC : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 20,000.00	10	pc	P
4	TIMER RELAY ON/OFF DELAY (220V) : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 20,000.00 ##### nothing follows #####	10	pc	P

Date of Delivery: _____
Price Validity : _____
Mode of Payment: _____

Place of Delivery: GSCWD Bodega

****No partial delivery allowed****

Note: 6% WITHHOLDING TAX DEDUCTION

PR NO.: 0324-050

Requested by:

GESEM R. CABAÑERO
Supervising Material
Planning Officer

Price quoted by:

Supplier

Date



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
E. Fernandez St., Brgy. Lagao, General Santos City
Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960
E-mail Address: gscwaterdistrict@yahoo.com
www.gensanwater.gov.ph

Pilot Light 220V Yellow



REQUIREMENTS	
Lens Color	Yellow
LED Voltage	220V AC
LED Nominal Current	20 mA
Insulation Resistance	100 Mohm at 500V DC
Operating Temperature	-25 C to 55°C
Recommended Wire Size	Copper Wire 14-16 AWG
Degree of Protection	IP 65

Prepared by:


Pithumpry C. Nobles, REE, RME
Engineering Assistant

Approved by:

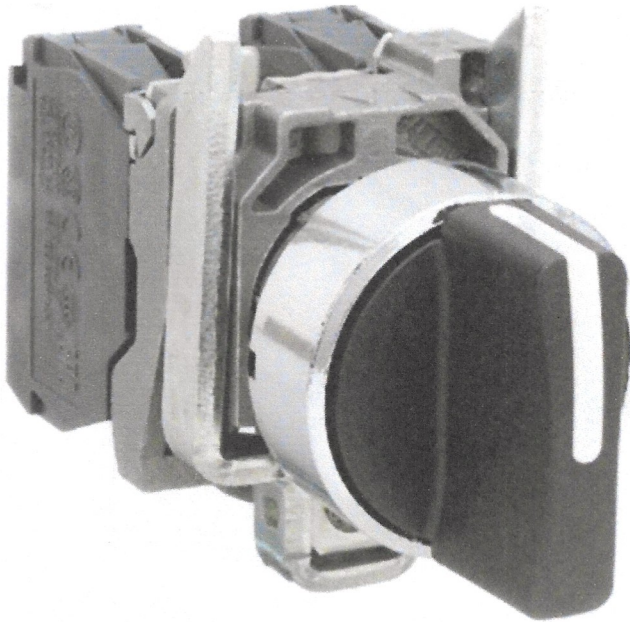

Edmund L. Badal, REE
Acting Division Manager – WQPEMD

Safe Water... Our Thrust, Our Service, Our Commitment.



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
E. Fernandez St., Brgy. Lagao, General Santos City
Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960
E-mail Address: gscwaterdistrict@yahoo.com
www.gensanwater.gov.ph

Selector Switch



REQUIREMENTS	
Number of Position	3
Selector Switch Type	Selector Switch Complete Unit
Actuator Type	Knob
Contact Configuration	2NO
IP Rating	IP 67, TP69K
Angle of Throw	45 degrees
Maximum Current	10 Amperes
Terminal Type	Screw
Illuminated	No
Maximum AC Voltage	600 volts

Prepared by:


Pithumpry C. Nobles, REE, RME
Engineering Assistant

Approved by:

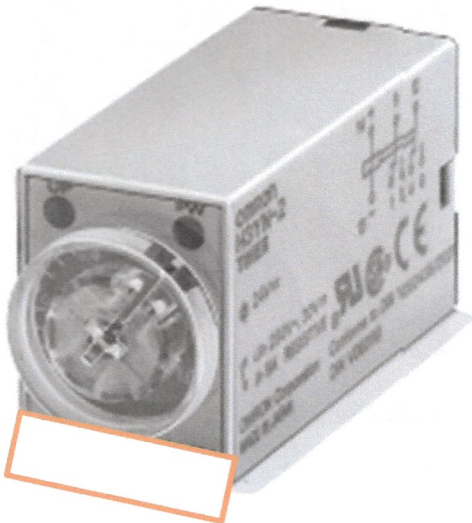

Edmund L. Badal, REE
Acting Division Manager – WQPMD

Safe Water... Our Thrust, Our Service, Our Commitment.



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
 E. Fernandez St., Brgy. Lagao, General Santos City
 Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960
 E-mail Address: gscwaterdistrict@yahoo.com
 www.gensanwater.gov.ph

Timer Relay 12V DC



REQUIREMENTS	
Supply Voltage	12 V DC
Frequency	50/60 HZ
Operating Voltage Range	85% to 110% of rated
Terminal Type	Plug In
With Socket	
Life Expectancy:	Mechanical: 10,000,000 operations
	Electrical: 500,000 operations
Insulation Resistance	100 MΩ min. at 500 VDC
Accuracy	±1% FS max. (1 s range: ±1%±10 ms max.)
Maximum Operating Temperature	10 to 50°C
IP Protection	IP 40
Contact Configuration	DPDT

Prepared by:


Pithumpry C. Nobles, REE, RME
 Engineering Assistant

Approved by:


Edmund L. Badal, REE
 Acting Division Manager – WQPEMD

Safe Water... Our Thrust, Our Service, Our Commitment.



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
E. Fernandez St., Brgy. Lagao, General Santos City
Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960
E-mail Address: gscwaterdistrict@yahoo.com
www.gensanwater.gov.ph

Timer Relay On/Off Delay (220V)



REQUIREMENTS	
Supply Voltage	220 V AC
With Timer Relay Slot	14
Switching Current	5 Amperes
Terminal Type	Plug In
With Socket	
Maximum Switching Voltage AC	250V ac
Maximum Switching Voltage DC	30V DC
Coil Resistance	18.9k Ω
Coil Power	1.1W
Maximum Operating Temperature	70°C
Maximum Operating Temperature	-55°C
Contact Configuration	DPDT

Prepared by:


Pithumpry C. Nobles, REE, RME
Engineering Assistant

Approved by:


Edmund L. Badal, REE
Acting Division Manager – WQPEMD

Safe Water... Our Thrust, Our Service, Our Commitment.