



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
 E. Fernandez Street, Barangay Lagao General Santos
 Telephone No.: 552-3824; Telefax No.: 553-4960
 Email Address: gscwdprocurement@yahoo.com

GPM-014-4

REQUEST FOR QUOTATION

RFQ #: 3-0424-017 DATE: 4/2/2024

SUPPLIER: _____
 ADDRESS: _____
 TELEPHONE NO. : _____
 TIN NO. : _____

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 4/6/2024, Pls. furnish this office the following articles subject to the terms and conditions contained therein.


Instructions :

1. Accomplish this Request for Quotation duly, correctly, and completely.
2. Do not alter the contents of this form in any way.
3. If Technical Specifications/ Terms of Reference is provided, prospect bidder (supplier / service provider) must indicate and signify compliance to every perimeter in the specification.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	15 MM DIA MULTI-JET BRASS WATER METER : PLEASE SEE ATTACHED SPECIFICATIONS (ABC: PHP 975,000.00) ##### nothing follows #####	390	pc	P

Date of Delivery: _____
 Price Validity : _____
 Mode of Payment: _____

Place of Delivery: GSCWD Bodega
 *****No partial delivery allowed*****
 Note: 6% WITHHOLDING TAX DEDUCTION
 PR NO.: 0324-079

Requested by:

 ARNEL S. NIVALADA
 General Santos City Water District

Price quoted by:

 Supplier

 Date



PURCHASE OF THREE HUNDRED NINETY (390) PIECES 15 MM DN MULTI-JET BRASS WATER METER


Project Title: Purchase of Three Hundred Ninety (390) pieces 15 mm DN multi-jet brass water meter.
 ABC: Php975, 000.00
 Owner: General Santos City Water District
 Scope of Work: The scope of work shall be the supply, delivery and testing of water meters to General Santos City Water District.

I. GENERAL REQUIREMENTS			
A.	NOMINAL DIAMETER	15 MM	STATEMENT OF COMPLIANCE
B.	METER TYPE	Multi-Jet, Magnetic Drive, Dry Type	
C.	METROLOGICAL CLASS	ISO 4064: 1993 Class "B" or equivalent to its latest edition	
D.	Meter Design	Flow is bi-directional (<i>no non-return valve at outlet portion</i>)	
		Meter registry is irreversible	
		Hermetically sealed register (encapsulated to prevent moisture from entering)	
		Only impeller is in contact with the water to prevent wear and tear of the inner mechanism	
		Clear tempered high impact lens and abrasion resistant.	
		Anti-magnetic type	
		Meter capacity should be placed preceded by the letter "N" or Qn or as defined by ISO 4064 equivalent edition	
E.	WORKING CONDITION	Working Pressure: 10-16 Bars	
		Water Temperature: The meter can work without deterioration on temperature at local climate	
F.	METROLOGICAL CHARACTERISTICS (MINIMUM PERFORMANCE)	Minimum Flowrate (Q_{min}) = 0.03 m ³ /h; Allowable error in accuracy is $\pm 5\%$	
		Transitional Flowrate (Q_t) = 0.12 m ³ /r; Allowable error in accuracy is $\pm 2\%$	
		Maximum Flowrate (Q_{max}) = 3.0 m ³ /h; Allowable error in accuracy is $\pm 2\%$	
		Nominal Flowrate (Q_n) = 1.5 m ³ /h; Allowable error in accuracy is $\pm 2\%$	
		Note: Application of flowrates during testing will be based on its Metrological Class	
G.	STRAINER SCREEN	Meter fitted with strainer on inlet to protect against dirt	
H.	BIDDERS QUALIFICATION	Bidder shall be an authorized dealer / reseller of the offered product for after sales and support.	

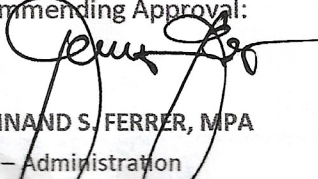
ADDITIONAL REQUIREMENTS:		STATEMENT OF COMPLIANCE
A. TECHNICAL BROCHURE	Bidders are required to submit technical brochure/specifications for further evaluation of the offered product.	
	One percent (1%) of the total quantity shall undergo random water meter test in Meter Testing Laboratory. The winning bidder shall pay the corresponding cost of testing.	
B. EFFICIENCY TEST	If twenty percent (20%) of the total number of water meters tested Failed the efficiency test, the procuring Entity (GSCWD) shall have the option to rescind or cancel the contract.	
	Random water meter testing shall be witnessed by three (3) GSCWD representatives. All costs such as transportation, hotel accommodation, meals, allowances and other related expenses shall be borne by the winning supplier. Testing shall be completed in one (1) day excluding travel period.	
	There shall be a representative from the winning bidder during random testing.	
	The water meters shall be randomly tested for accuracy in a Water Meter Laboratory for Transitional and Minimum flow rates. These flow rates shall be the basis for the meter to PASS or FAIL in the Accuracy Test.	
	After Delivery: All water meters delivered shall be subjected to accuracy test at GSCWD water meter laboratory. All cost related to the return of failed water meters and its replacement shall be borne by the supplier.	
C. TERMS OF DELIVERY	390 pcs 15mm Water Meter Complete Sets – 30 Calendar Days upon receipt of Purchase Order. (One time delivery)	
D. OTHER PACKAGE	With plastic end cap installed to both meter body thread ends.	
	Each meter individually packed in a small box containing 2 threaded tailpieces and 2 rubber gasket that fitted to its outlet design of the manufacturer.	
	Also, the winning bidder shall provide additional 195 pcs rubber gaskets and an additional 195 pcs tailpieces.	
	Length requirement of each tailpieces is 75mm with ±5mm tolerance	
	The tailpieces shall be of the same material composition as the meter body.	
E. BIDDERS QUALIFICATION	Bidder shall be an authorized dealer / reseller of the offered product for after sales and support.	


Prepared by:

TECHNICAL WORKING GROUP FOR WATER METER


MARY ANN SANDY D. PINOS, ME
 TWG - Member


MICHAEL C. GABALES, REE
 TWG - Head

Recommending Approval:

FERDINAND S. FERRER, MPA
 AGM – Administration

Approved by:

FRANCISCO R. ALOLOD JR. CPA, CESE
 Acting General Manager