



Republic of the Philippines  
 GENERAL SANTOS CITY WATER DISTRICT  
 E. Fernandez Street, Barangay Lagao General Santos  
 Telephone No.: 552-3824; Telefax No.: 553-4960  
 Email Address: gscwdprocurement@yahoo.com

GPM-014-4

**REQUEST FOR QUOTATION**

RFQ #: 3-0724-026      DATE: 7/9/2024

SUPPLIER: \_\_\_\_\_  
 ADDRESS: \_\_\_\_\_  
 TELEPHONE NO. : \_\_\_\_\_  
 TIN NO. : \_\_\_\_\_

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 7/13/2024, Pls. furnish this office the following articles subject to the terms and conditions contained therein.

Instructions :

1. Accomplish this Request for Quotation duly, correctly, and completely.
2. Do not alter the contents of this form in any way.
3. If Technical Specifications/ Terms of Reference is provided, prospect bidder (supplier / service provider) must indicate and signify compliance to every parameter in the specification.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	MAIN BREAKER 250AMPS, 3 PHASE, 60HZ, 460V, 50 KAIC RATING : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 50,100.00	3	<ignor	P
2	CIRCUIT BREAKER 150 AMPS : PLEASE SEE ATTACHED SPECIFICATIONS/ PICTURE-ABC: PHP 37,500.00 ##### nothing follows #####	3	pc	P

Date of Delivery: \_\_\_\_\_  
 Price Validity : \_\_\_\_\_  
 Mode of Payment: \_\_\_\_\_

Place of Delivery: GSCWD Bodega  
 \*\*\*\*\*No partial delivery allowed\*\*\*\*\*  
 Note: 6% WITHHOLDING TAX DEDUCTION  
 PR NO.: 0324-107

Requested by:

Price quoted by:

*ANDREW H. NADAL, JR.*  
 Material Procurement Officer A

\_\_\_\_\_  
 Supplier


\_\_\_\_\_  
 Date



Republic of the Philippines  
**GENERAL SANTOS CITY WATER DISTRICT**  
E. Fernandez St., Brgy. Lagao, General Santos City  
Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960  
E-mail Address: gscwaterdistrict@yahoo.com  
[www.gensanwater.gov.ph](http://www.gensanwater.gov.ph)

---

## MAIN CIRCUIT BREAKER 250 AMPS

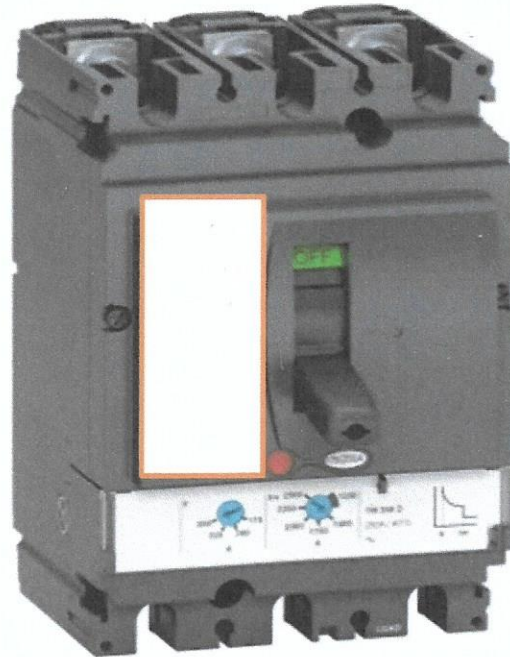


*Safe Water... Our Thrust, Our Service, Our Commitment.*



Republic of the Philippines  
**GENERAL SANTOS CITY WATER DISTRICT**  
E. Fernandez St., Brgy. Lagao, General Santos City  
Telephone No. (083) 552-3824 / Telefax No. (083) 553-4960  
E-mail Address: gscwaterdistrict@yahoo.com  
[www.gensanwater.gov.ph](http://www.gensanwater.gov.ph)

---

## MAIN CIRCUIT BREAKER 150 AMPS

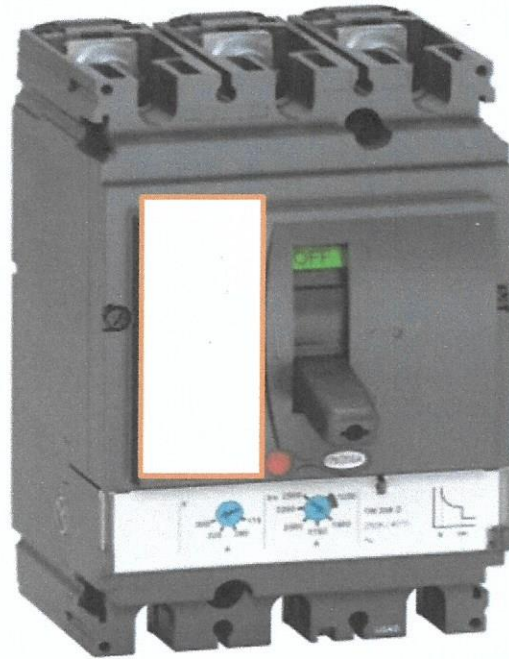

*Safe Water... Our Thrust, Our Service, Our Commitment.*



## TECHNICAL SPECIFICATION

### TITLE: PURCHASE OF MAIN CIRCUIT BREAKER 150 AMPS

#### 1.0 General Scope

The scope of work shall be supply and delivery of Main Circuit Breaker (150 Amps) to General Santos City Water District.

#### 2.0 General Specification

Item	Technical Specification	Statement of Compliance
1	Main Circuit Breaker (150 Amps)	
2	Breaking Capacity: 50 kAIC	
3	Rated AC Voltage: 460 V	
4	Rated Frequency: 60HZ	
5	IP Rating: IP 55	
6	3-Phase	
7	Without enclosure	
8	Overvoltage category: Class II	
9	Electrical Shock Protection: Class II	



Republic of the Philippines  
GENERAL SANTOS CITY WATER DISTRICT (GSCWD)  
GSCWD Bldg., E. Fernandez Street (Emergency Road), Lagao, General Santos City  
Telephone No.: 552-3824/554-7231; Telefax No.: 553-4960  
E-mail Address: gscwaterdistrict@yahoo.com

### 3.0 TERMS AND CONDITIONS

1. The scope of work shall be supply and delivery of Main Circuit Breaker (150 Amps) to General Santos City Water District (GSCWD).
2. The winning bidder is required to submit the following but not limited to data sheets and operating manual.
3. The winning bidder shall deliver the Main Circuit Breaker (150 Amps) within **Sixty (60)** calendar days upon receipt of Purchase Order (PO).
4. That the winning bidder shall have an available qualified and trained technicians 24/7 in case of equipment failure.
5. The winning bidder shall be subjected to Liquidated Damages (LD) for each day of delay as provided by the IRR of RA 9184.
6. That the winning bidder shall issue a warranty certificate of not less than one (1) year and the warranty shall commence from the date of commissioning of the unit.

Prepared by:

  
**EDMUND L. BADAL, REE**  
TWG - Member

Approval:

  
**MICHAEL G. GABALES, REE**  
TWG - HEAD



## TECHNICAL SPECIFICATION

### TITLE: PURCHASE OF MAIN CIRCUIT BREAKER 250 AMPS

#### 1.0 General Scope

The scope of work shall be supply and delivery of Main Circuit Breaker (250 Amps) to General Santos City Water District.

#### 2.0 General Specification

Item	Technical Specification	Statement of Compliance
1	Main Circuit Breaker (250 Amps)	
2	Breaking Capacity: 50 kAIC	
3	Rated AC Voltage: 460 V	
4	Rated Frequency: 60HZ	
5	IP Rating: IP 55	
6	3-Phase	
7	Without enclosure	
8	Overtoltage category: Class II	
9	Electrical Shock Protection: Class II	



Republic of the Philippines  
GENERAL SANTOS CITY WATER DISTRICT (GSCWD)  
GSCWD Bldg., E. Fernandez Street (Emergency Road), Lagao, General Santos City  
Telephone No.: 552-3824/554-7231; Telefax No.: 553-4960  
E-mail Address: gscwaterdistrict@yahoo.com

### 3.0 TERMS AND CONDITIONS

1. The scope of work shall be supply and delivery of Main Circuit Breaker (250 Amps) to General Santos City Water District (GSCWD).
2. The winning bidder is required to submit the following but not limited to data sheets and operating manual.
3. The winning bidder shall deliver the Main Circuit Breaker (250 Amps) within **Sixty (60)** calendar days upon receipt of Purchase Order (PO).
4. That the winning bidder shall have an available qualified and trained technicians 24/7 in case of equipment failure.
5. The winning bidder shall be subjected to Liquidated Damages (LD) for each day of delay as provided by the IRR of RA 9184.
6. That the winning bidder shall issue a warranty certificate of not less than one (1) year and the warranty shall commence from the date of commissioning of the unit.

Prepared by:

  
**EDMUND L. BADAL, REE**  
TWG - Member

Approval:

  
**MICHAEL G. GABALES, REE**  
TWG - HEAD