



Republic of the Philippines  
**GENERAL SANTOS CITY WATER DISTRICT**  
 E. Fernandez Street, Barangay Lagao General Santos  
 Telephone No.: 552-3824; Telefax No.: 553-4960  
 Email Address: gscwdprocurement@yahoo.com

GPM-014-4

**REQUEST FOR QUOTATION**

RFQ #: 3-0724-086      DATE: 7/31/2024

SUPPLIER: \_\_\_\_\_  
 ADDRESS: \_\_\_\_\_  
 TELEPHONE NO. : \_\_\_\_\_  
 TIN NO. : \_\_\_\_\_

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 8/4/2024, Pls. furnish this office the following articles subject to the terms and conditions contained therein.

Instructions :

1. Accomplish this Request for Quotation duly, correctly, and completely.
2. Do not alter the contents of this form in any way.
3. If Technical Specifications/ Terms of Reference is provided, prospect bidder (supplier / service provider) must indicate and signify compliance to every parameter in the specification.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	P.E. PIPE 3/4`` SDR 9 ISO : 300M/ROLL; PLEASE SEE ATTACHED SPECIFICATIONS-ABC: PHP 100,000.00	3000	mtrs	P
2	P.E. PIPE 1`` SDR 9 ISO : 300M/ROLL; PLEASE SEE ATTACHED SPECIFICATIONS-ABC: PHP 200,000.00	3000	mtrs	P
3	P.E PIPE 1 1/2`` SDR 17 : 60M/ROLL-ABC: PHP 25,000.00 ##### nothing follows #####	240	<ignor	P

Date of Delivery: \_\_\_\_\_  
 Price Validity : \_\_\_\_\_  
 Mode of Payment: \_\_\_\_\_

Place of Delivery: GSCWD Bodega  
 \*\*\*\*\*No partial delivery allowed\*\*\*\*\*  
 Note: 6% WITHHOLDING TAX DEDUCTION  
 PR NO.: 0724-042

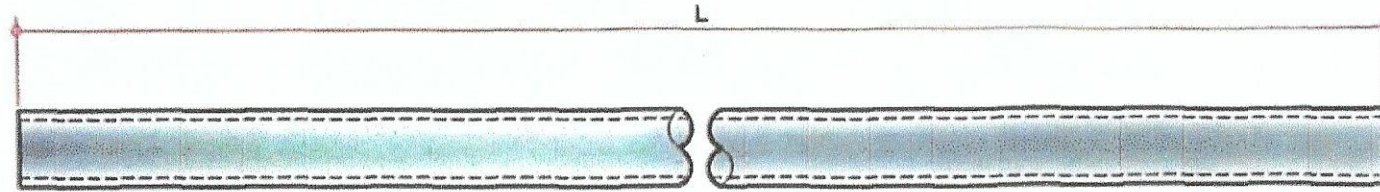
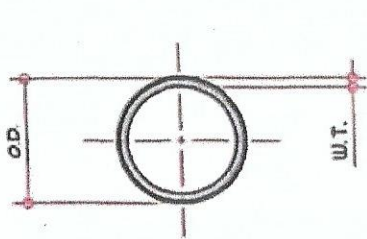
Requested by:

Price quoted by:

**ANDREW H. NADAL, JR.**  
 Material Procurement Officer A

\_\_\_\_\_  
 Supplier  
 \_\_\_\_\_  
 Date






# HDPE PIPE



## STANDARD HDPE PIPE

NOMINAL PIPE SIZE		OUTSIDE DIAMETER (O.D.)	INSIDE DIAMETER (I.D.)	STANDARD LENGTH/COL (L)	MINIMUM WALL THICKNESS (MM)
INCHES	MM	MM	MM	METERS	SDR - 9
1/2	15	20	15.40	300	2.30
3/4	20	25	19.40	150	2.80
1	25	32	24.80	100	3.60
1 1/2	40	50	38.80	60	4.50
2	50	63	48.80	60	7.10
2 1/2	65	75	58.20	60	8.40
3	80	90	69.20	6	10.10
4	100	110	85.40	6	12.30
6	150	160	124.20	6	17.90

RAW MATERIALS : PE100

Project Title	Prepared By	Checked By	Reviewed By	Recommending for approval by	Approved by	Comments	Sheet no.
STANDARD SHOP DRAWING FOR HDPE PIPE	 Engr. D. Alm Principal Draftsman B	 Engr. M. Montador, Jr., CE Project Planning & Dev't Office (A)	 Engr. M. Dandan, CE Acting Dept. Manager - ECD	 Engr. T. Torres, Jr., CE Acting Asst. General Manager - OTS	 Engr. A. Besana, Jr., CERMP Acting General Manager	As shown Revision Date: 07/10/2023	1



Republic of the Philippines  
**GENERAL SANTOS CITY WATER DISTRICT**  
E. Fernandez St., Brgy. Lagao, General Santos City  
Telephone No. (083) 552-3824/ Telefax No. (083) 553-4960  
E-mail Address: gscwaterdistrict@yahoo.com  
www.gensanwater.gov.ph


## Additional Requirements for P.E Pipe Markings

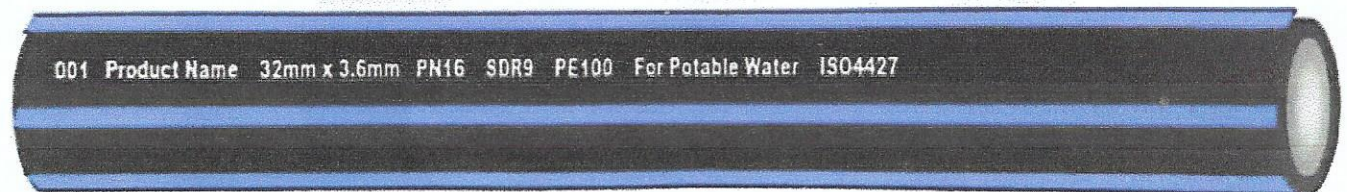The markings on the P.E. pipe must be clear, easily visible, and resistant to erasure, ensuring convenient identification during cutting to locate both the number and length of the pipe being cut.

The P.E Pipe must have a standard color of **Black with Blue Stripes**

The pipe shall be clearly marked with the following and must be spaced at intervals of not more than one meter. (Please see attached drawing as an example)

1. Name of Product
2. Nominal outside diameter, mm
3. Nominal Pressure (PN)
4. SDR Number
5. Type of PE Material the pipe was made
6. Manufacturer's name or its recognized trademark
7. The words "For Potable Water" or "Water"
8. PNS ISO 4427 must be indicated
9. Length Indicator (in number)



Prepared by:

  
Kevin J. Ante, MPA

Clerk Processor B  
Procurement, Quality Control and Property Division

*Safe Water... Our Thrust, Our Service, Our Commitment.*