



Republic of the Philippines
GENERAL SANTOS CITY WATER DISTRICT
E. Fernandez Street, Barangay Lagao General Santos
Telephone No.: 552-3824; Telefax No.: 553-4960
Email Address: gscwdprocurement@yahoo.com

GPM-014-2

REQUEST FOR QUOTATION

RFQ #: 3-0823-038 DATE: 8/14/2023

SUPPLIER: _____
ADDRESS: _____
TELEPHONE NO. : _____
TIN NO. : _____

Dear Sir/Madam,

Pls. quote your lowest price on the item/s listed below subject to general condition stating the shortest time of delivery and submit your quotation duly signed by your representative not later than 8/18/2023, Pls. furnish this office the following articles subject to the terms and conditions contained therein.

ITEM NO.	DESCRIPTION	QTY.	UNIT	UNIT PRICE
1	D.I. SLEEVE TYPE COUPLING 50MM (2``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 65,000.00	50	pc	P
2	D.I. SLEEVE TYPE COUPLING 75MM (3``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 75,000.00	50	pc	P
3	D.I. SLEEVE TYPE COUPLING 100MM (4``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 100,000.00	50	pc	P
4	D.I. SLEEVE TYPE COUPLING 150MM (6``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 150,000.00	50	pc	P
5	D.I. SLEEVE TYPE COUPLING 200MM (8``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 225,000.00	50	pc	P
6	D.I. SLEEVE TYPE COUPLING 250MM (10``) : PLEASE SEE ATTACHED PICTURE/SPECIFICATIONS-ABC: PHP 140,000.00 ##### nothing follows #####	20	pc	P

Date of Delivery: _____
Price Validity : _____
Terms of Payment: _____

Place of Delivery: GSCWD Bodega

****No partial delivery allowed****

Note: 6% WITHHOLDING TAX DEDUCTION

PR NO.: 0723-083


Requested by:

GESEM R. CABANERO
MATERIAL PROCUREMENT
OFFICER A

Price quoted by:

Supplier

Date

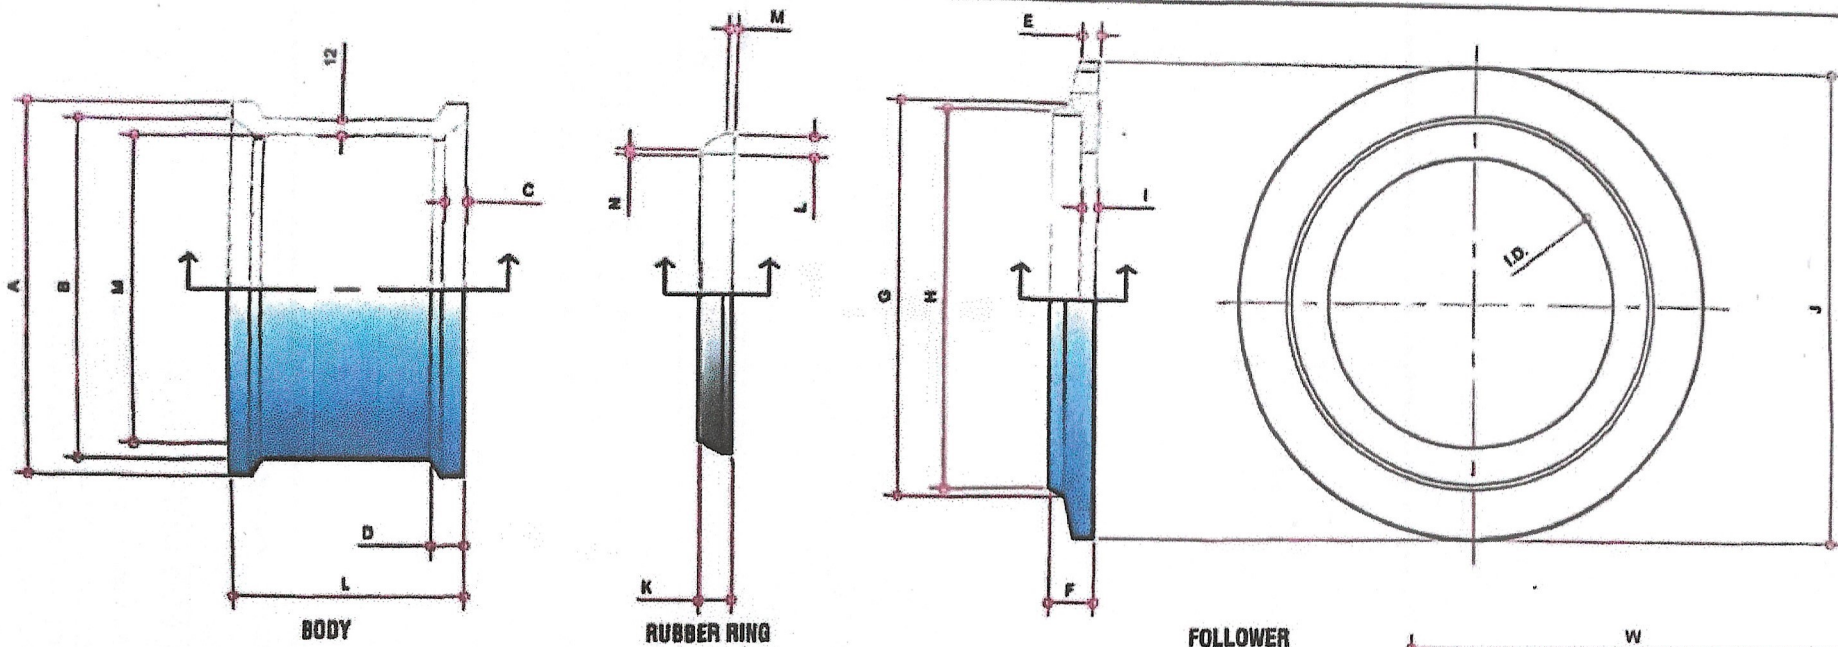

NOMINAL SIZE mm(in.)	PIPE O.D.	BODY								FOLLOWER						BOLTS & NUTS			RUBBER RING			
		I.D.	A	B	C	D	L	M	t	E	F	G	H	I	J	W	Ø	No.	N	L	K	M
50 (2")	63	65	104	86	18	24	120	74	8	9	23	120	116	10	165	190	12.5	4	5	14	20	6
75 (3")	90	92	137	114	19	24	132	105	12.19	10	23	156	154	10	200	220	14	4	5	14	24	6
100 (4")	110	112	158	140	21	24	147	117	13.20	10	25	180	178	12	232	220	14	4	5	14	26	7
100 (4")	110	112	158	140	21	24	147	117	13.20	10	25	180	178	12	232	220	14	4	5	14	26	7
150 (6")	160	163	214	190	24	24	174	175	13.90	12	29	233	231	13	285	255	16	5	5	16	26	7
200 (8")	225	228	281	256	25	25	180	230	15.20	15	34	301	299	13	365	280	16	8	5	16	26	7
250 (10")	260	263	325	310	26	25	185	260	17.30	15	34	342	340	13	412	280	16	8	5	17	26	7

- NOTES:**
1. ALL DIMENSION ARE IN MILLIMETER UNITS.
 2. MATERIALS IS CAST IRON CONFORM TO ASTM A - 128 CLASS B
 3. INTERNAL AND EXTERNAL COATING ELECTROSTATICALLY APPLIED EPOXY POWDER IN COMPLIANCE WITH AWWA C-550
 4. MATERIALS OF BOLTS AND NUTS IS HOT DIP GALVANIZED IRON
 5. GASKET FOR AWWA C-111 AND SHALL BE EPDM, SBR, NBR, CONFORMING TO ISO 4633 CLASS 70, AND SUITABLE FOR DRINKING WATER.
 6. RATED WORKING PRESSURE SHALL BE 200 PSI

GENERAL SANTOS CITY WATER DISTRICT
 L. FERNANDEZ STREET, BDOY. LAGAO, GEN. SANTOS CITY
 ENGINEERING & CONSTRUCTION DEPARTMENT
 PLANNING AND DESIGN DIVISION
 TEL. NO.: (052) 9422 - 3824

PROJECT TITLE / LOCATION: STANDARD SHOP DRAWING FOR SLEEVE TYPE COUPLING	CHECKED BY: <i>[Signature]</i> ENGR. DANLO M. HORLADOR, JR. Project Planning & Development Officer &	REVIEWED BY: <i>[Signature]</i> ENGR. MARIA CELIA N. DANDAN P/C - Planning & Design Division	APPROVED BY: <i>[Signature]</i> ENGR. ROGELIO A. BESANA, JR. ADM - Operations & Technical Services	CONTINUE: AS SHOWN	SHEET NO.:
				DRAWN: ESA CHECKED:	REVISION: DATE: 10/10/2022